


DRIP VALVE: VALVE MAY BE OF ANY TYPE. IF VALVE HAS HOSE THREADS  
A NON-REMOVABLE VACUUM BREAKER MUST BE INSTALLED.

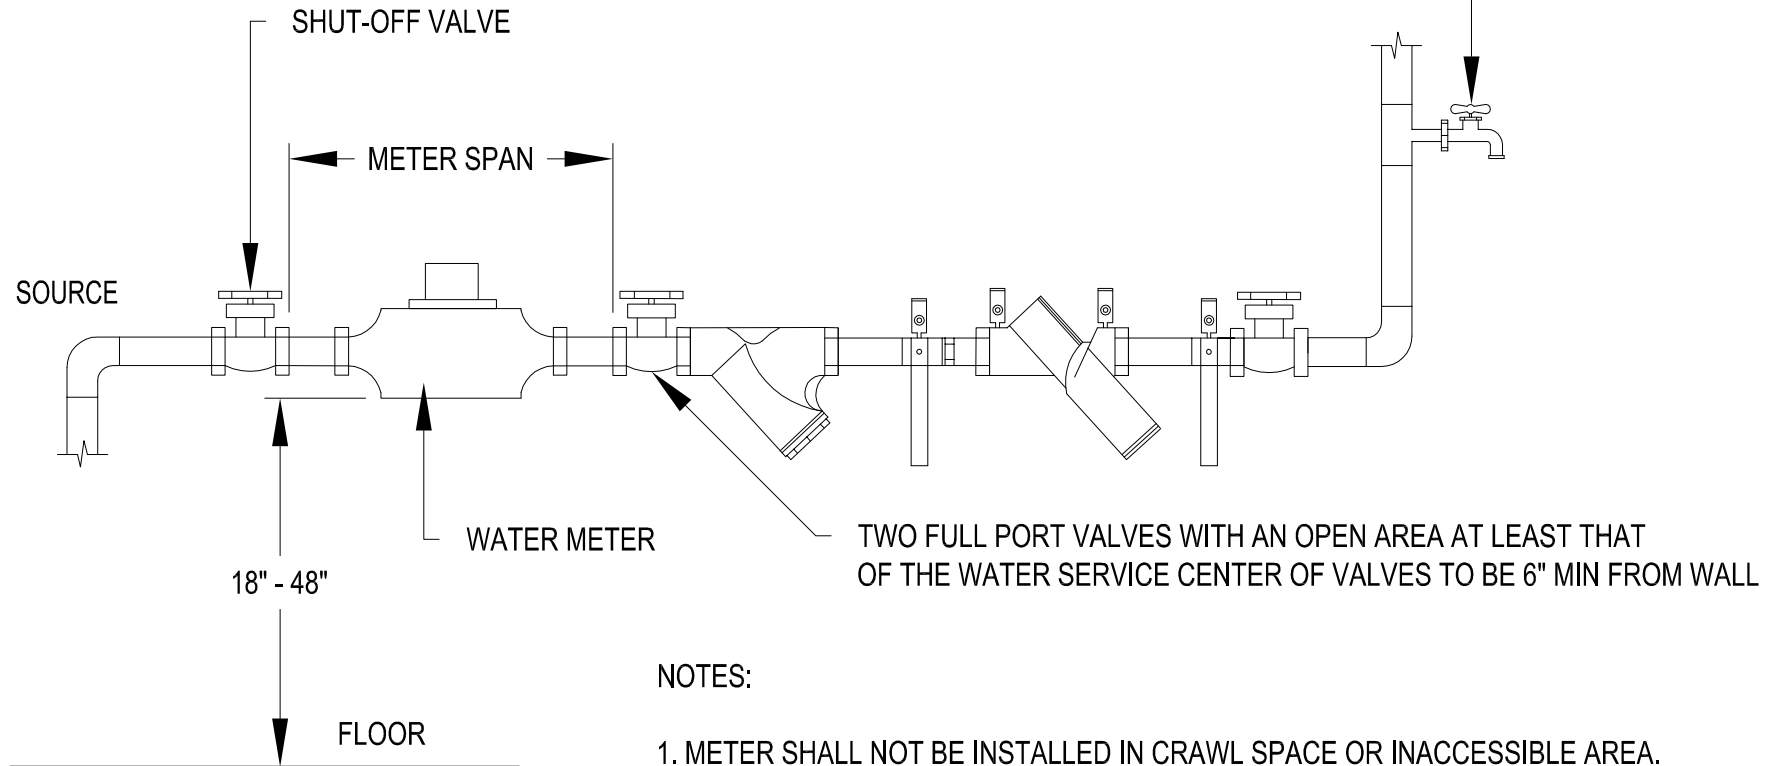

NOTES:

1. METER SHALL NOT BE INSTALLED IN CRAWL SPACE OR INACCESSIBLE AREA.
2. BACKFLOW DEVICE PER ILLINOIS STATE PLUMBING CODE REQUIREMENTS.
3. MINIMUM 12" OF CLEARANCE ABOVE THE METER.
4. METER TO MEET MANUFACTURERS SPECIFICATIONS FOR UPSTREAM PIPE REQUIREMENTS.

Revised:
1. 06/12/2015
2.
3.
4.

Drawing Name
<b>WATER METER INSTALLATION WITH BACKFLOW PREVENTOR</b>

Drawing Number
UW-11
Date: 06/10/2015
Drawn      Checked
JH          VR



City of  
**Crystal Lake**  
I l l i n o i s