


DRIP VALVE: VALVE MAY BE OF ANY TYPE. IF DRIP VALVE HAS HOSE THREADS, A NON-REMOVABLE VACUUM BREAKER MUST BE INSTALLED

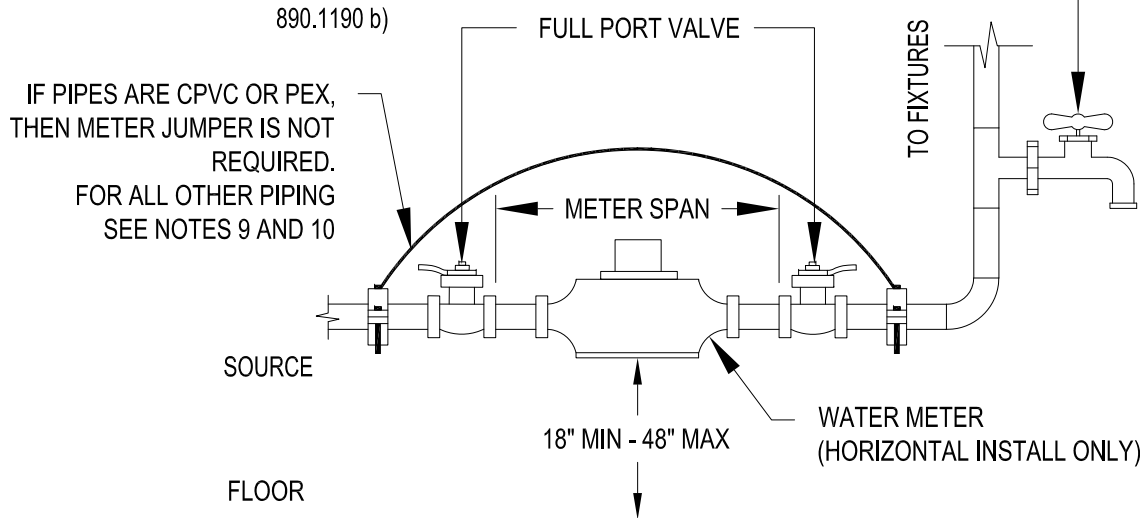

NOTES:

1. IF METER IS TO BE ENCLOSED, REMOVABLE PANELS SHALL BE USED SO THAT ACCESS TO THE METER AND VALVES IS PROVIDED.
2. ACCESS PANEL OPENING MUST BE LARGER THAN METER FOR REMOVAL, INSTALLATION OR SERVICE.
3. IF ENCLOSED, METER MUST BE 6" - 24" BACK FROM ENCLOSURE.
4. PROVIDE MINIMUM 12" OF CLEARANCE ABOVE METER.
5. METER SHALL BE INSTALLED INSIDE THE HEATED PORTION OF THE BUILDING IN AN ACCESSIBLE LOCATION.
- 6. METER SHALL NOT BE INSTALLED IN A CRAWL SPACE OR PIT.**
7. METER TO MEET MANUFACTURERS SPECIFICATIONS FOR UPSTREAM PIPE REQUIREMENTS.
8. EACH METER REQUIRES INDIVIDUAL WATER SERVICE LINE WITH SHUT OFF VALVE IN RIGHT OF WAY. (SEE UW-04)
9. IF 100 AMP ELECTRIC SERVICE, THEN METER JUMPER SHALL BE #8 COPPER (JUMPER NOT NEEDED FOR CPVC OR PEX PIPING)
10. IF 200 AMP ELECTRIC SERVICE, THEN METER JUMPER SHALL BE #4 COPPER (JUMPER NOT NEEDED FOR CPVC OR PEX PIPING)

Revised:
1. 09/22/2015
2. 03/07/2016
3. 08/18/2023 JRG- LEVER STYLE VALVE
4. 12/26/2024 JRG- ADDED NOTES 8, 9, AND 10

Drawing Name
TYPICAL WATER METER INSTALLATION

Drawing Number
UW-10
Date: 06/10/2015
Drawn Checked
DD VR

